


ECLIPSE NO. 8 POST HYDRANT

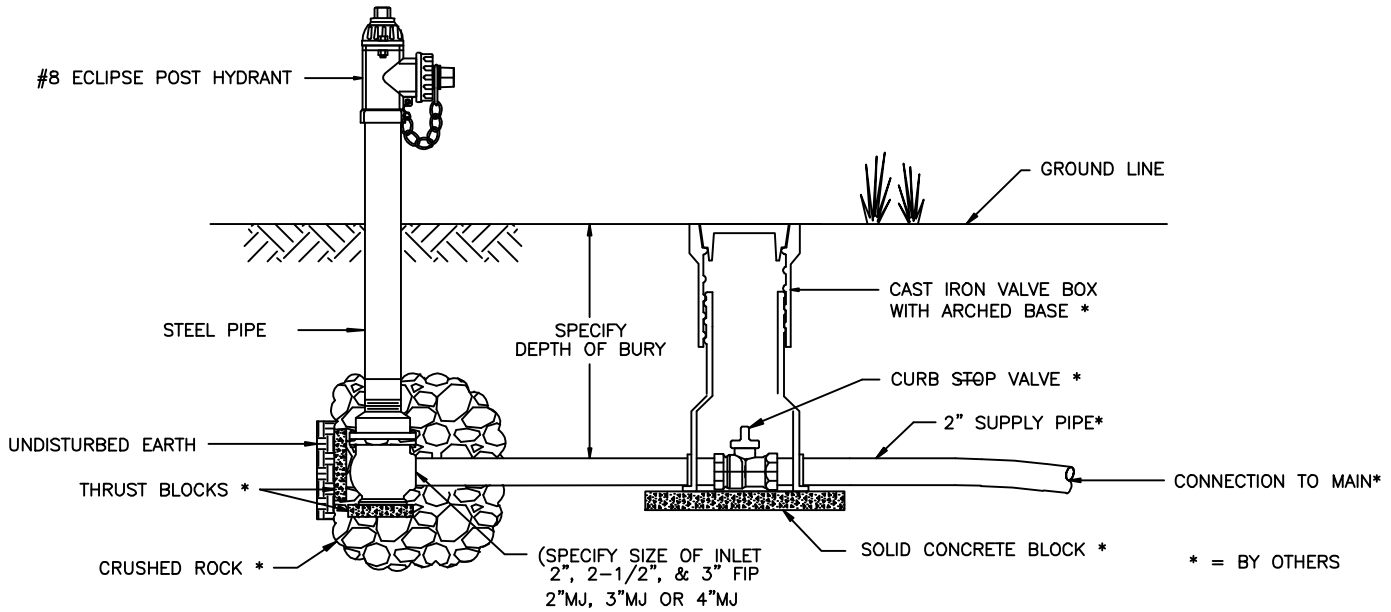


Hydrants shall be self-draining, non-freezing, compression type with 2-3/16" main valve opening. Inlet connection shall be (2" MJ, 3" MJ OR 4" MJ). Outlet shall be 1-1/4", 1-1/2" 2" or 2-1/2" IP or NST).

Hydrants shall have a 3 1/2" steel pipe riser with a cast iron stock top, and non-turning operating rod. Principal interior operating parts shall be brass and removable from the hydrant for servicing without excavating the hydrant.

Hydrants shall be set in 4 cubic feet of crushed stone to allow for proper drainage of the hydrant. Recommendations of the AWWA should be followed when installing the hydrants.

Post hydrants shall be Eclipse No. 8 Post Hydrants as manufactured by John C. Kupferle Foundry Company, St. Louis, MO.

			DRAWN G.B.	
			APPROVED	
			DATE	4/07
			MAT'L	
<p>THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.</p>				
NO	DATE	REVISION	PART NO. #2 ECLIPSE POST HYDRANT	SHEET 1 OF 1



KUPFERLE FOUNDRY COMPANY
 2811 NORTH 8TH STREET, ST. LOUIS, MO 63102
 314-891-8728 800-891-8880 FAX 314-213-8820
<http://www.hydrants.com>