




Eclipse #82

Stainless Steel Sampling Station

FEATURES:

- All stainless steel design
- 2" blow-off
- Non-freezing temperature controlled drain valve - no hand pump required
- 3/8" sampling point
- Lockable UV resistant enclosure
- Optional powder-coated steel or stainless steel enclosures
- 1" model (Eclipse #82A) available

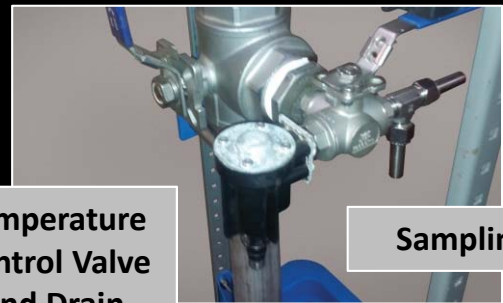

Temperature Control Valve and Drain

Sampling Point



Certified to NSF/ANSI 372

Secure, Lockable Enclosure (hex lock)



Use the map to the left as a guide for choosing the proper Eclipse #82 Series Sampling Station :

YELLOW = Eclipse #82WC
PURPLE = Eclipse #82




UV Resistant Enclosure



Optional Lockable Powder-Coated Steel Enclosure

#82 FREEZE PROOF HYDRANT

Multiple purpose freeze proof blow-off and sampling device shall be installed in the following locations:

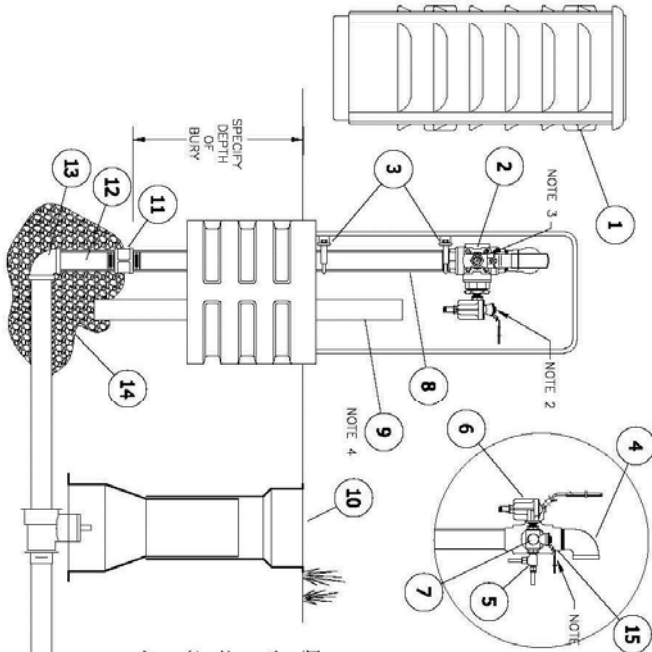

ITEM	ITEM / DESCRIPTION	BY OTHERS / OPTIONAL
1	UV RESISTANT LOCKABLE LID	
2	2" 3-WAY S.S. BALL VALVE	
3	MOUNTING BRACKET	
4	2" NPT S.S. DISCHARGE	
5	S.S. SAMPLING POINT	
6	FREEZE PROTECTION VALVE	
7	1/2" 3-WAY S.S. BALL VALVE	
8	2" S.S. WATERWAY	X
9	3" min. PVC DRAIN	X
10	VALVE BOX	X
11	2" S.S. COUPLING	X
12	2" S.S. NIPPLE	X
13	2" S.S. ELBOW	X
14	1" CLEAN ROCK	X
15	THREAD 10-32 DRAIN HOLE	

LAYOUT NOTES:

- 1.) 3-WAY SAMPLING VALVE SHOWN IN THE FREEZE PROTECTION POSITION.
 - 2.) 3-WAY SAMPLING VALVE SHOWN IN THE SAMPLING POSITION.
 - 3.) MAIN 2" 3-WAY BLOW-OFF VALVE SHOWN IN THE FREEZE PROTECTION POSITION.
 - 4.) A DRAIN SHALL BE INSTALLED TO ALLOW THE FREEZE PROTECTION VALVE TO DRAIN BELOW THE FROST LINE.
 - Ø 20" - APPROXIMATELY 13 GALLONS PER DAY
 - Ø 10" - APPROXIMATELY 42 GALLONS PER DAY
- THE EXACT AMOUNT OF WATER DISPENSED DEPENDS ON AMBIENT AIR TEMPERATURE, MAKE UP WATER TEMPERATURE, AND DURATION OF COLD SPELL.

The #82 Freeze Proof Sampling Station shall be a standard 20" bury, with a 2" NPT inlet and a 2" NPT threaded discharge. A 3/8" Stainless Steel I compression shall be located before the discharge to allow for sampling. A 2" Stainless Steel Ball Valve shall control the flow of water for the main discharge. The unit shall be fully enclosed in a UV resistant lockable cover and when opened, the station shall require no key for operation. All water flow must be thru Stainless Steel and all operational parts shall be serviceable from above ground without any digging. A temperature activated water relief valve shall maintain a controlled water temperature within the waterway by opening the valve port when the water temperature reaches 43°F and remain open until warmer water reaches the port, thus creating a non freezing environment. The freeze proof cycle shall repeat as often as necessary to prevent freezing.

Unit model # shall be 82 as manufactured by Kupferle Foundry Company, St. Louis MO (1-800-231-3990), or approved equal.

NOTE: Flush water lines free of debris before installation

DATE	ISSUED FOR REFERENCE	STATUS / REVISION

THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.

SHEET 1 OF 1	SCALE 1/2"=1'	DATE 1/10/13
#82 SPEC SHEET		

DRAIN DCL	
CHECKED DCL	
APPROVED DCL	

2611 NORTH 9TH STREET, ST. LOUIS, MO 63102
314-231-8728 800-231-3990 FAX 314-231-2820
http://www.hydrants.com

ECLIPSE™



2511 North 9th Street, St. Louis, MO 63102
800-231-3990 toll free / www.hydrants.com / 314-231-2820 fax