



#9800WC AUTOMATIC FLUSHING STATION SPEC SHEET


GENERAL HYDRANT SPECIFICATIONS	
MAXIMUM OPERATING PRESSURE:	220 PSI
HYDRANT MATERIALS:	303, 316, AND 18-8 STAINLESS STEEL, SCH. 80 PVC
ENCLOSURE MATERIAL:	UV RESISTANT PLASTIC
ENCLOSURE COLOR:	BLACK BASE WITH GREEN LID
WETTED MATERIALS:	SCH. 80 PVC, TEFLON, EPDM, 316 S.S.
DEPTH OF BURY:	1'
WEIGHT:	~30 LBS

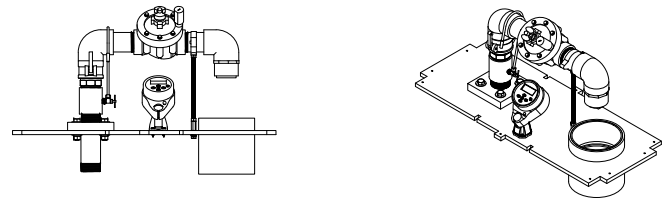


A 9800WC w/ GOOSENECK OPTION VIEWS
Scale: 1/2"=1'

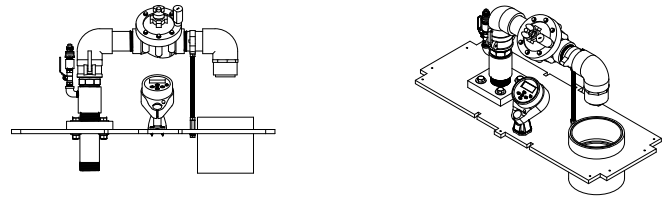


B 9800WC w/ 92-V OPTION VIEWS
Scale: 1/2"=1'

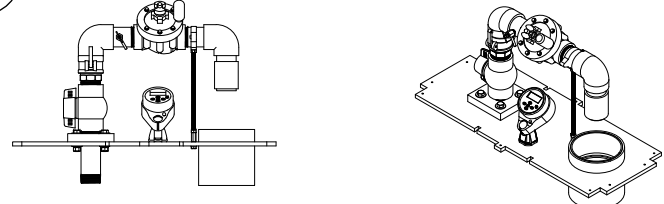


C 9800WC w/ BALL VALVE OPTION VIEWS
Scale: 1/2"=1'

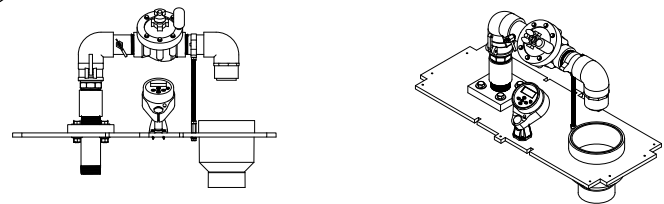


D 9800WC w/ DRAIN REDUCER OPTION VIEWS
Scale: 1/2"=1'

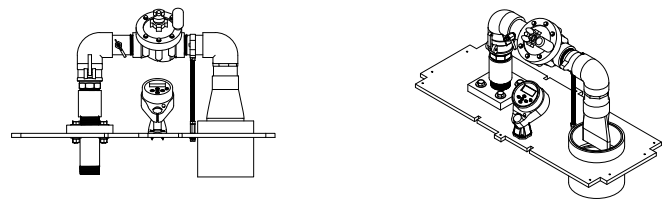


E 9800WC w/ DUCKBILL OPTION VIEWS
Scale: 1/2"=1'

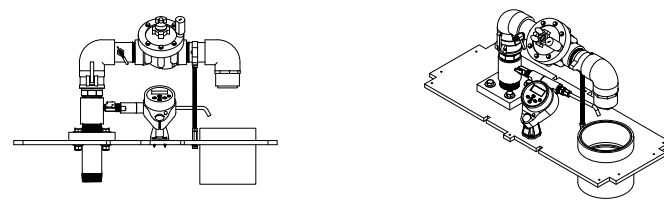

F 9800WC w/ ANTI FREEZE VALVE OPTION VIEWS
Scale: 1/2"=1'




F STREAM SHAPER VIEW
Scale: 3"=1'



G PETCOCK VIEW
Scale: 3"=1'




H 92-V VIEW
Scale: 1-1/2"=1'

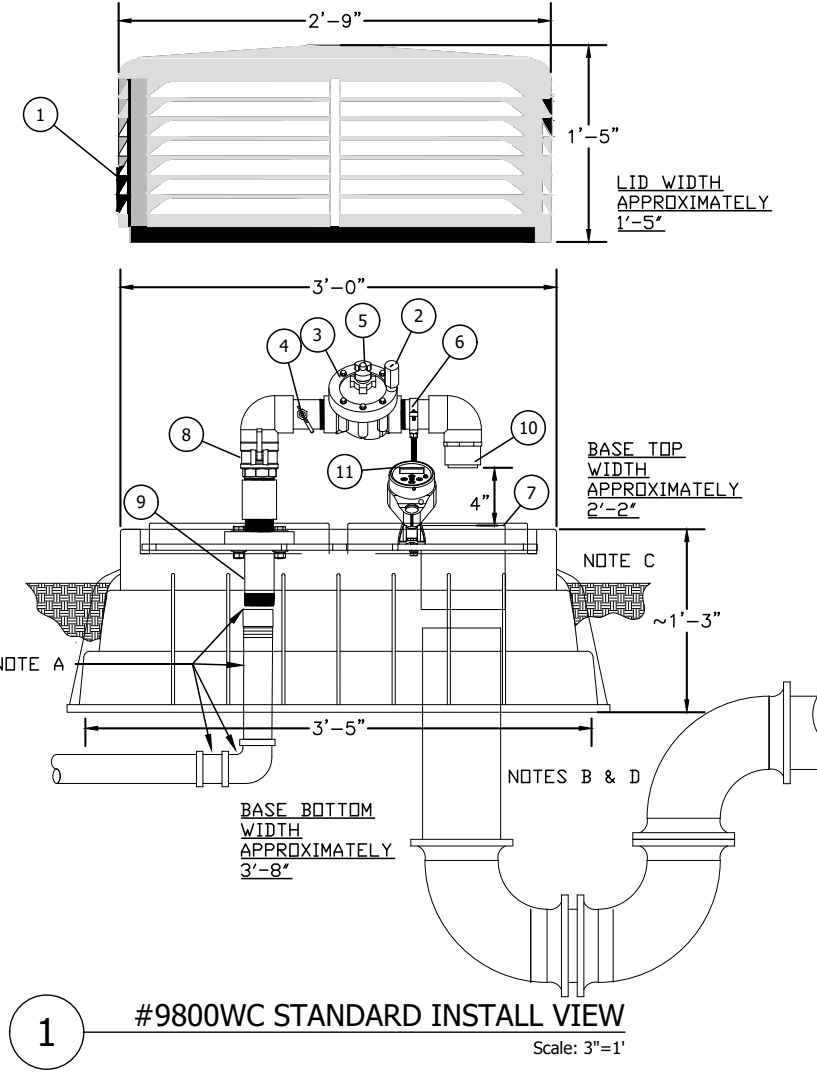

1 #9800WC STANDARD INSTALL VIEW
Scale: 3"=1'

Automatic Product Ordering Guide													
MODEL#	9800	-	WC	-	0	-	B	-	X	-	A	-	X
SUBSECTION	1	2	3	4	5	6	7						
SUBSECTION DESCRIPTION	MODEL #	SUBSECTION	OPTIONS		DESCRIPTIONS								
MODEL	1	9800			AUTOMATIC FLUSHING DEVICE								
CLIMATE	2	WC			WARM CLIMATES								
DEPTH OF BURY	3	0.0			X.X = FEET DEPTH OF BURY. ENTER # IN FEET AND INCLUDE INCHES. ROUND TO NEAREST 0.5 FOOT.								
SAMPLING OPTIONS	4		A		1/4" COPPER GOOSENECK								
			B		STAINLESS STEEL PETCOCK (STD)								
			C		92-V SAMPLING VALVE								
ABOVE GRADE BALL VALVE	5		X		NONE (STD)								
			A		BALL VALVE								
OUTLET OPTIONS	6		A		6" SEWER PIPE COUPLING (STD)								
			B		6" X 4" SEWER PIPE REDUCER								
			C		2" DUCKBILL VALVE								
			D		6" SDR 35 x PVC SCH 40 COUPLING								
			E		S.S. TEMPERATURE ACTIVATED WATER RELIEF VALVE								
DECHLORINATION	7		X		NONE (STD)								
			A		SIPHON STYLE								
			B		OUTLET BASKET								
		C		IN-LINE BASKET									

ITEM	DESCRIPTION	NOTES
1	UV RESISTANT LOCKABLE LID	
2	DC LATCHING SOLENOID	
3	2" AUTOMATIC FLUSHING VALVE	
4	STAINLESS STEEL PETCOCK	
5	FLOW ADJUSTMENT KNOB	
6	2" PIPE CLAMP	
7	6" SEWER PIPE OUTLET	
8	2" S.S. QUICK DISCONNECTS	
9	2" MIP INLET	
10	STREAM SHAPER	
11	VALVE CONTROLLER	

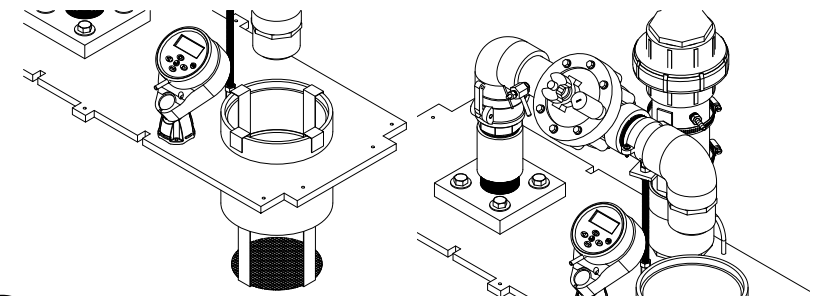

K 9800WC w/ BASKET & SIPHON DECHLOR OPTION VIEWS
Scale: 1"=1'

Automatic Flushing Station (AFS) shall be installed in the following location(s): _____

Automatic flushing station shall have a 2" stainless steel MIP inlet that will lead vertically through a pair of stainless steel quick disconnects to the 2" automatic flushing valve. The flushing valve shall control the flow of the water through the hydrant and its diaphragm with the extension and retraction of a DC latching solenoid. The valve shall have a 220 PSI rating. All flushed water shall be directed via a stream shaper to reduce the residual water spray in the enclosure.


Each unit shall be furnished with a stand alone valve controller. The valve controller will not require a second hand-held device for programming. Controller must have a minimum of 12 possible flushing cycles per day. Controller shall be submersible up to 12 feet, operate with two 9 volt batteries, and have resin sealed electrical components. The solenoid shall have no loose parts when removed from the valve.

The removal of the 2" valve shall be possible via a pair of above-ground stainless steel quick disconnects to allow for easy removal of all the operating parts of the hydrant. The flushing valve shall be installed at 45° to allow the removal of the solenoid and cap for routine maintenance purposes.

Each unit shall have a dedicated sampling point on the hydrant located before the 2" flushing valve. Unit shall allow for the installation of dechlorination options.

Valve assembly shall be housed in a UV resistant lockable enclosure with a removable cover.

Unit model # shall be 9800WC as specified in the product ordering guide as manufactured by Kupferle Water Solutions, St. Louis MO, or approved equal.

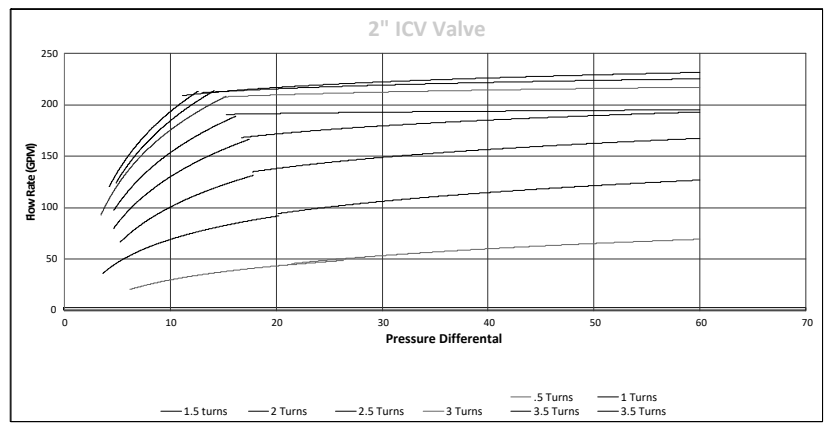

NOTES	
A	PIPING BY OTHERS
B	KUPFERLE RECOMMENDS THE INSTALLATION OF A PEE TRAP ON THE DRAIN PART OF THE HYDRANT.
C	GROUND LINE MAY VARY
D	DRAIN TO BE DESIGNED TO HANDLE FULL FLOW APPROPRIATELY, UNDERSIZED OUTLET MAY RESULT IN RESIDUAL SPLASHING

	INITIALS	DATE
DRAWN	SMS	10/1/18
APPROVED	DCL	10/4/18
MODIFIED	KJW	11/08/24
SHEET SIZE	B (11x17)	SCALE VARIES


KUPFERLE
 WATER SOLUTIONS
 2511 NORTH 9TH STREET
 ST. LOUIS, MO 63102
 1-800-231-3990
 FAX 314-231-2820
 www.hydrants.com

DATE	STATUS / REVISION

PATENTED