


#1- TOTAL ECLIPSE YARD HYDRANT

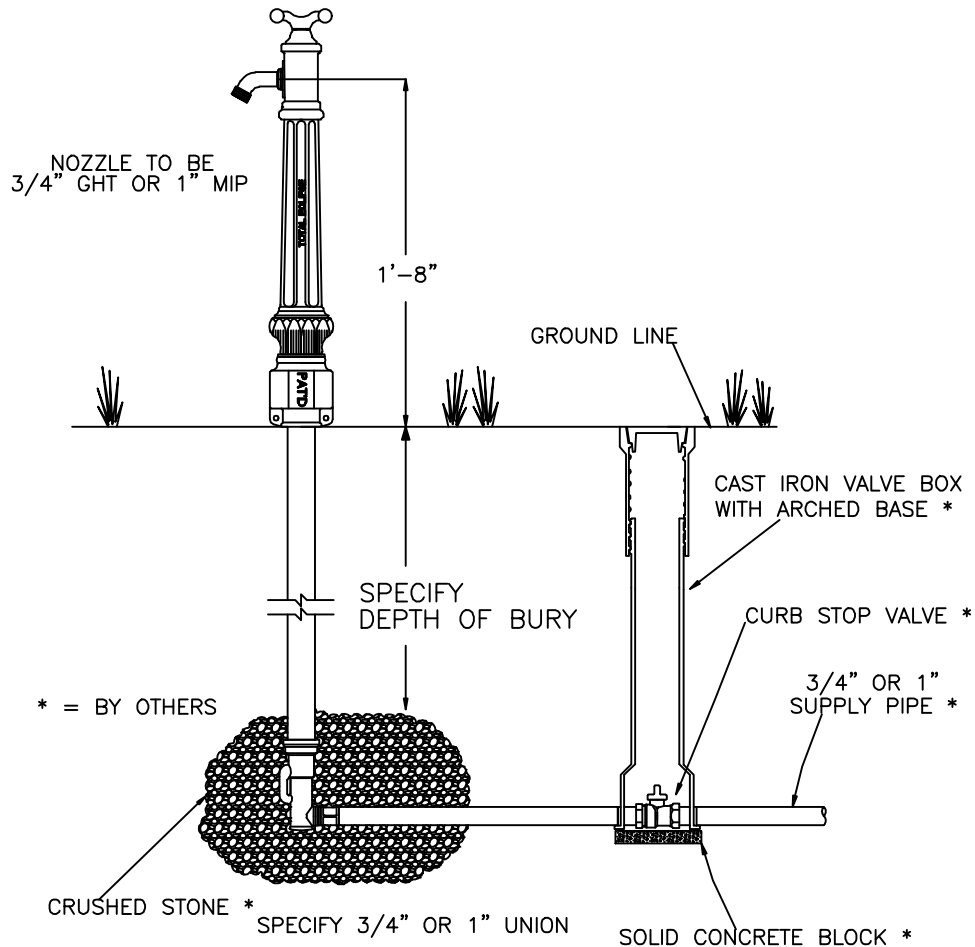


Hydrants shall be self-draining, non-freezing, compression type. Inlet shall be 3/4" or 1" MNPT. Outlet shall be 3/4" mnpt or ght, or 1" MNPT.

Yard Hydrants shall have a (steel (STD), galvanized steel, stainless steel, or brass) exterior casing pipe, a (steel (STD), galvanized steel or brass) interior operating rod with a (cast iron (STD), or aluminum or brass) casing guard.

Principal interior operating parts shall be brass and bronze and be removable from hydrant without excavating. Hydrant shall have a 4-Spoke ball wheel operating handle.

Hydrants shall be set in 4 cubic feet of crushed stone to allow for proper drainage of the hydrant. Recommendations of the AWWA should followed when installing the hydrant.

Post hydrants shall be total Eclipse Eclipse No. 1 Yard Hydrant as manufactured by John C. Kupferle Company, St. Louis, MO or approved equal.

		DRAWN F.M.		
		APPROVED		
		DATE 1-3-13		<hr/> <hr/> KUPFERLE FOUNDRY COMPANY <hr/> <hr/> 2511 NORTH 8TH STREET, ST. LOUIS, MO 63102 314-231-8738 800-231-3990 FAX 314-231-2620 http://www.hydrants.com
		MATL		
		THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.		
DATE	REVISION	PART NO. #1 TOTAL ECLIPSE YARD HYDRANT		