


# # 36 STREET WASHER

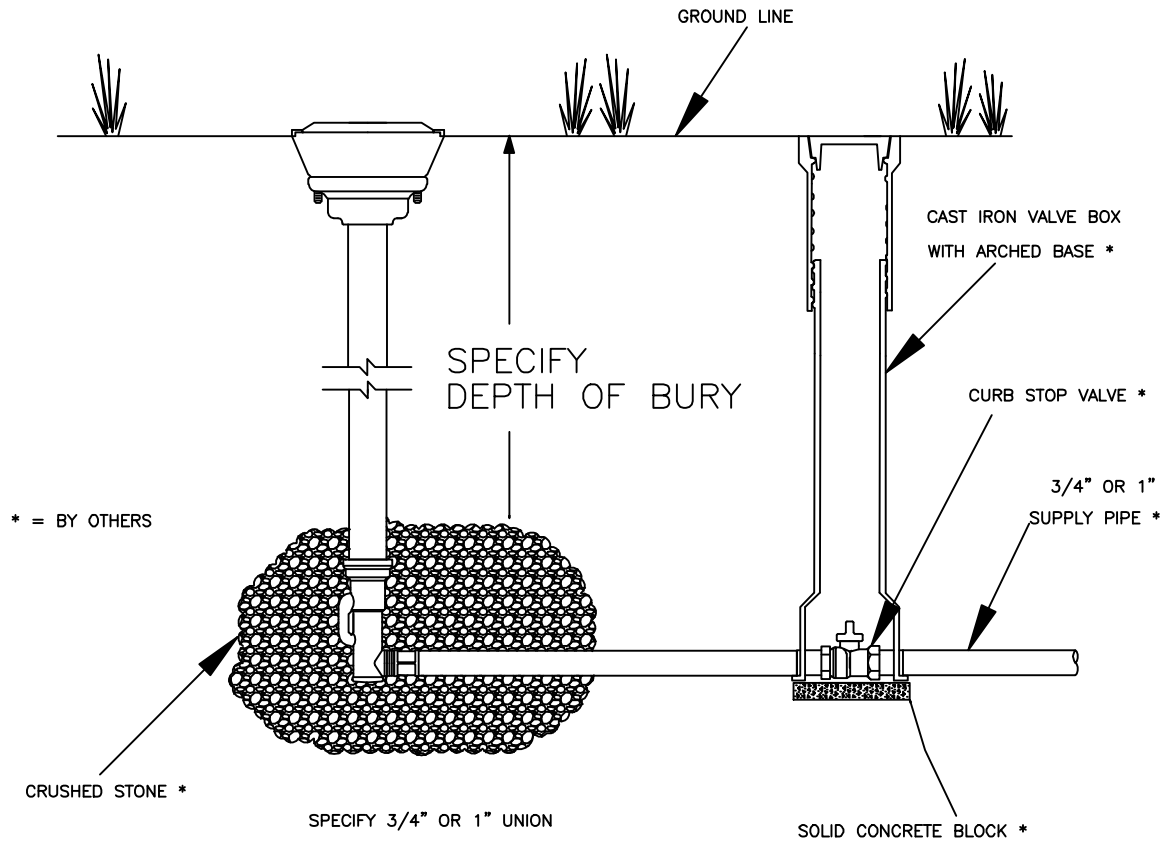

\* = BY OTHERS

CRUSHED STONE \*

SPECIFY 3/4" OR 1" UNION

SOLID CONCRETE BLOCK \*

Below grade Ground Hydrants shall be self-draining, non-freezing, compression type. Inlet shall be 3/4" or 1" MNPT. Outlet shall be 3/4" MNPT or GHT, or 1" MNPT.

Ground Hydrants shall have a (steel (STD), galvanized steel, stainless steel, or brass) exterior casing pipe, a (steel (STD), galvanized steel or brass) interior operating rod with a (cast iron (STD), or aluminum or brass) casing guard.

Principal interior operating parts shall be brass and bronze and be removable from hydrant without excavating. Hydrant shall be operated by a "T" Handle.

Ground Hydrants shall be set in 4 cubic feet of crushed stone to allow for proper drainage of the hydrant. Recommendations of the AWWA should followed when installing the hydrant.

Below grade hydrants shall be Total Eclipse Eclipse No. 36 Ground Hydrant as manufactured by John C. Kupferle Company, St. Louis, MO or approved equal.

NO	DATE	REVISION

THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.

DRAWN  
F.M.

APPROVED

DATE  
1-4-13

PART NO. #36 STREET WASHER

**ECLIPSE**  
Since 1880

**KUPFERLE FOUNDRY COMPANY**

2811 NORTH 9TH STREET, ST. LOUIS, MO 63162  
314-291-8738 800-291-3968 FAX 314-291-2828  
<http://www.hydrants.com>

SCALE TO FIT