


#44MS-4 MOUNTABLE MONITOR STAND SPEC SHEET

GENERAL HYDRANT SPECIFICATIONS	
MAXIMUM OPERATING PRESSURE:	200 PSI
NSF/ANSI:	NSF 372
REGULATORY COMPLIANCE:	

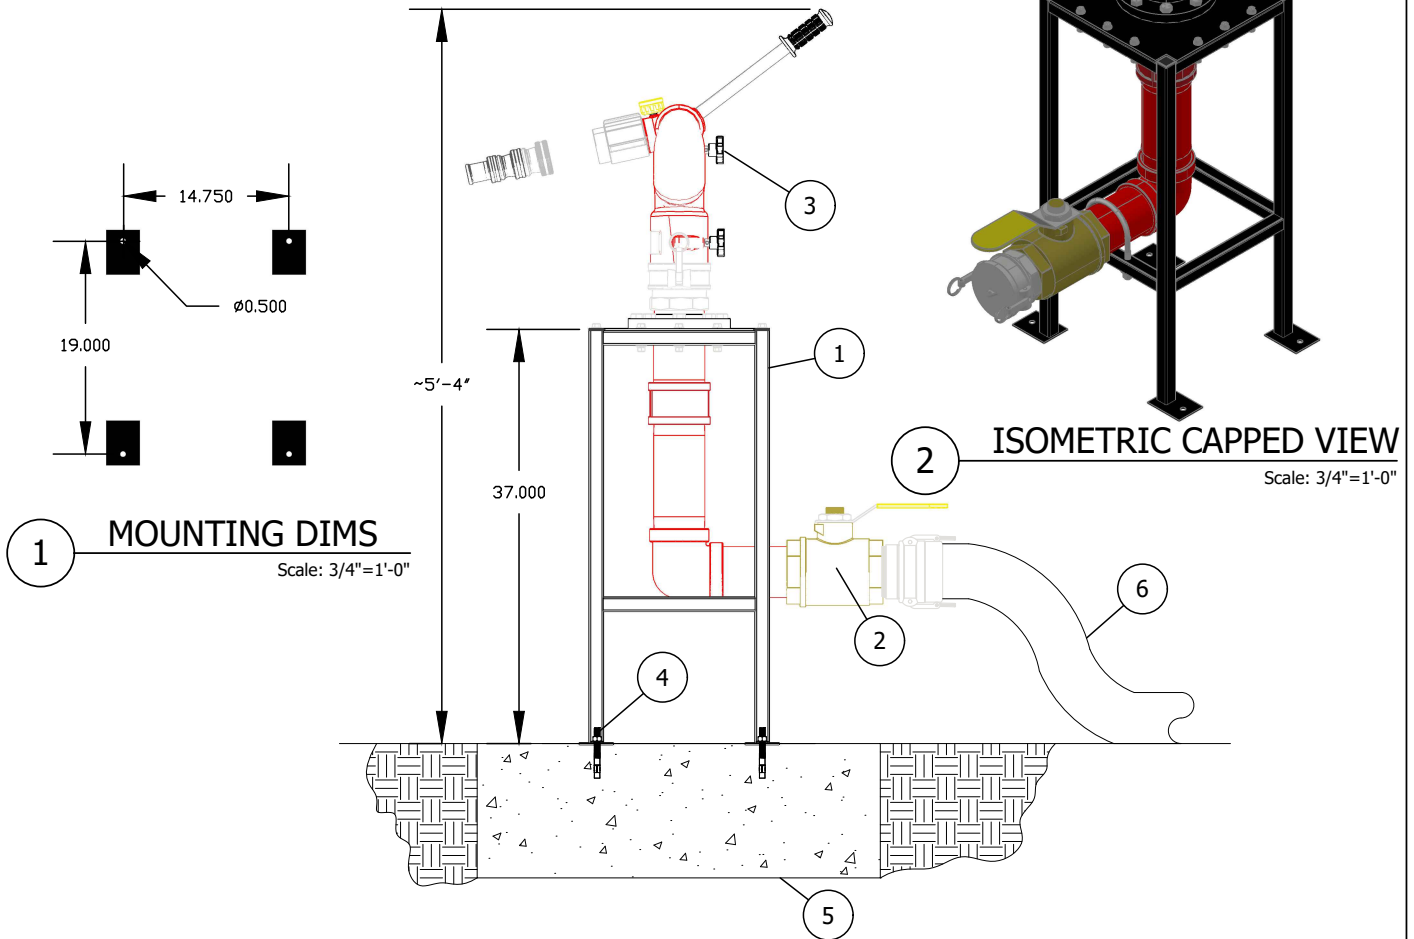

MOUNTABLE MONITOR STAND SHALL BE INSTALLED ON A CONCRETE PAD THAT IS AT LEAST 'x ' AND " THICK. STAND SHALL BE ANCHORED TO THE CONCRETE VIA CONCRETE ANCHORS OR LAGS. ANCHORS OR LAGS SHALL BE INSTALLED ACCORDING TO MANUFACTURERS INSTRUCTIONS.

A 4" MONITOR MAY BE ATTACHED TO THE TOP OF THE STAND VIA A PAIR OF STAINLESS STEEL QUICK DISCONNECTS. A SUPPLY LINE SHALL BE CONNECTED TO THE STAND VIA ANOTHER PAIR OF STAINLESS STEEL QUICK DISCONNECTS. A BALL VALVE DISCONNECT, LOCATED IMMEDIATELY AFTER THE INLET, SHALL ALLOW FOR FLOW CONTROL AT THE WASH DOWN LOCATION.

WATER MUST BE TURNED OFF AT THE SOURCE AND THE BALL VALVE PLACED IN THE OPEN POSITION BEFORE ANY QUICK DISCONNECTS ARE OPENED.

THE 4" MOUNTABLE MONITOR STAND AS MANUFACTURED BY KUPFERLE WATER SOLUTIONS, ST. LOUIS MO. OR APPROVED EQUAL.

ITEM	ITEM / DESCRIPTION	NOTES
1	4" MONITOR STAND	
2	4" BALL VALVE	
3	4" MOUNTABLE MONITOR HYDRANT	
4	CONCRETE ANCHORS/LAGS	BY OTHERS
5	CONCRETE PAD	BY OTHERS
6	4" SUPPLY LINE	BY OTHERS

MOUNTABLE MONITOR STAND TO BE INSTALLED AT THE FOLLOWING LOCATIONS:

DISCLAIMER: KUPFERLE'S #44MS HYDRANT AND MOUNTING STAND ARE DESIGNED TO BE USED ON POTABLE WATER SYSTEMS ONLY AND RATED FOR A MAXIMUM PRESSURE OF 200 PSI. PROPER ANCHORING OF THE STAND TO CONCRETE IS SOLEY THE RESPONSIBILITY THE INSTALLER.

DD/MM/YY	ISSUED FOR REFERENCE
DATE	STATUS / REVISION

#44MS-4 4" MOUNTABLE MONITOR STAND

	INITIALS	DATE
DRAWN	SMS	04/06/17
APPROVED	DCL	04/06/17
MODIFIED	ADC	03/06/26

SCALE
1"=1'



1291 N HIGHWAY DR
ST. LOUIS, MO 63026
1-800-231-3990
FAX 314-231-2820
www.hydrants.com

SHEET 1 OF 1