
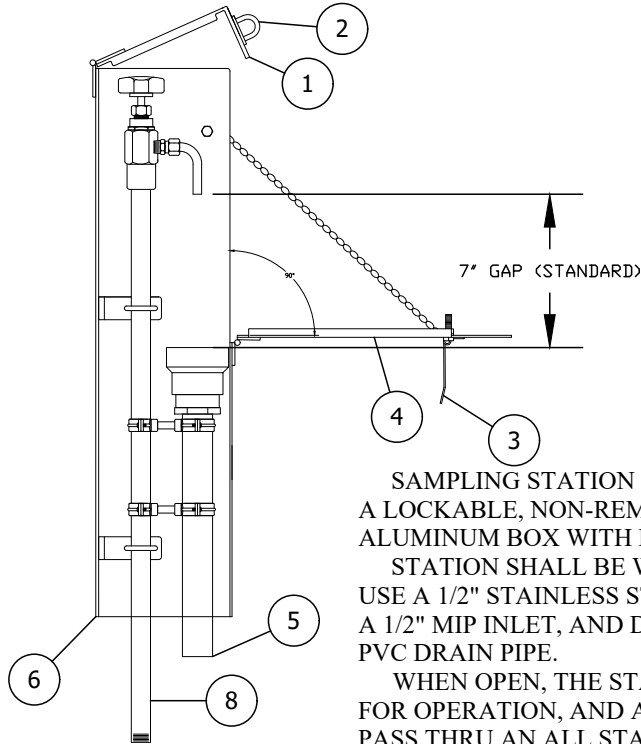


#66MB WALL MOUNT SAMPLING STATION SPEC SHEET

GENERAL HYDRANT SPECIFICATIONS	
MAXIMUM OPERATING PRESSURE:	220 PSI
NSF/ANSI:	NSF 372
REGULATORY COMPLIANCE:	

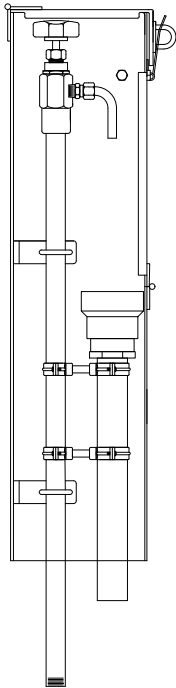

SAMPLING STATION SHALL BE ENCLOSED IN A LOCKABLE, NON-REMOVABLE 6" SQUARE ALUMINUM BOX WITH HINGED OPENINGS.

STATION SHALL BE WALL-MOUNTED, AND USE A 1/2" STAINLESS STEEL WATERWAY, WITH A 1/2" MIP INLET, AND DRAIN INTO A 1" SCH. 40 PVC DRAIN PIPE.


WHEN OPEN, THE STATION REQUIRE NO KEY FOR OPERATION, AND ALL WATER FLOW SHALL PASS THRU AN ALL STAINLESS STEEL WATERWAY. ALSO, WHEN OPEN THE STATION SHALL ALSO UTILIZE CHAINS ATTACHED TO FRONT DOOR AND INSIDE WALLS OF ENCLOSURE TO CREATE A FLIP-DOWN TABLE .

THE STATION SHALL BE MODEL #66MB AS MANUFACTURED BY KUPFERLE WATER SOLUTIONS, ST. LOUIS MO. OR APPROVED EQUAL.

NOTES:

IN SOME CONDITIONS CORROSION OF STAINLESS STEEL CAN OCCUR (EXPOSURE TO SALT WATER, DIRECT EXPOSURE TO STRONG CHLORIDES, ETC.). PROPER MAINTENANCE OF THE EXPOSED STAINLESS STEEL PARTS USING PROPER STAINLESS STEEL CLEANING AGENTS WILL INCREASE THE LIFESPAN OF THE HYDRANT. IF DESIRED, KUPFERLE CAN ALSO OFFER AN ADDITIONAL PASSIVATION PROCESS FOR ADDITIONAL CORROSION PROTECTION.

ITEM	ITEM / DESCRIPTION	NOTES
1	TOP ACCESS DOOR	
2	PADLOCK EYE	
3	PADLOCK HASP	
4	FRONT ACCESS DOOR	
5	1" SCH. 40 PVC DRAIN PIPE	
6	6" ALUMINUM SQUARE BOX	
7	WALL MOUNT BRACKETS	
8	1/2" S.S. WATERWAY	

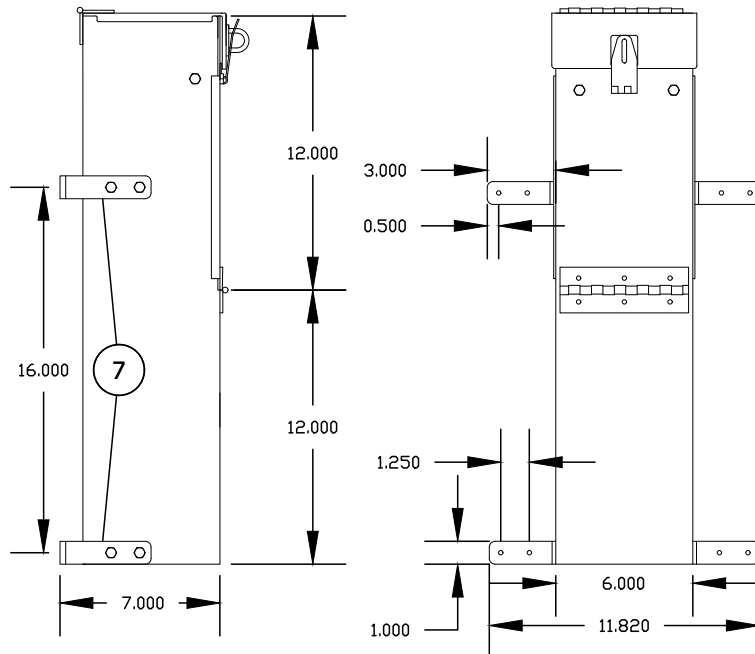

#66MB SAMPLING STATION TO BE INSTALLED AT
THE FOLLOWING LOCATIONS:

DD/MM/YY	ISSUED FOR REFERENCE
DATE	STATUS / REVISION

#66MB SAMPLING STATION

SHEET 1 OF 1

DRAWN
AKL
APPROVED
DCL
DATE
6/21/13
SCALE
1-1/2"=1'



1291 N HIGHWAY DR
ST. LOUIS, MO 63026
1-800-231-3990
FAX 314-231-2820
www.hydrants.com