


# MAINGUARD NO. 78 BLOW-OFF HYDRANT

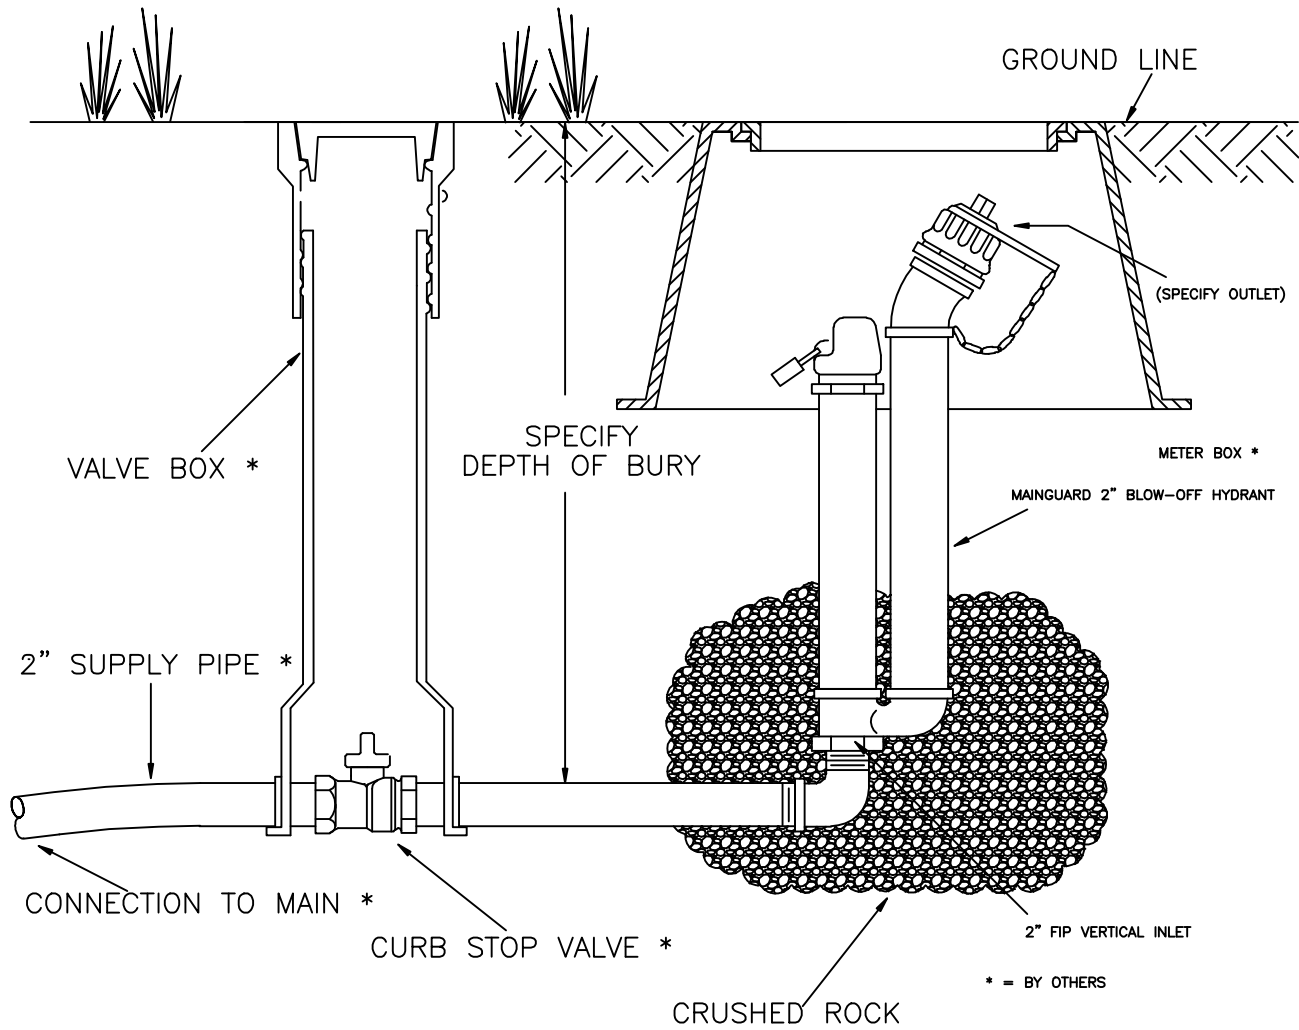

Blow-off Hydrants shall be non-freezing, self draining type with a depth of bury of \_\_\_\_'. Set underground in a customer provided meter box. These hydrants will be furnished with a 2' FIP inlet, a non-turning operating rod, and shall open to the left. All of working parts shall be of bronze-to-bronze design with an aluminum plunger and serviceable from above grade with no digging. The outlet shall be bronze and be 2½' NST or smaller. Hydrants shall be lockable to prevent unauthorized use as manufactured by Kupferle Foundry Co., St. Louis, Mo., or approved equal. (Specify depth of bury and overall length will be 6' shorter. Minimum opening in meter box should be 10'.)

DATE	REVISION

THIS DRAWING IS THE PROPERTY OF THE KUPFERLE FOUNDRY COMPANY. IT IS NOT TO BE USED OR DUPLICATED WITHOUT PERMISSION OF THE OWNER.

DRAWN F.M.
APPROVED
DATE 1-31-13
MAT'L

PART NO. #78 MAINGUARD BLOW OFF SHEET 1 OF 1

**ECLIPSE**  
Since 1857

**KUPFERLE FOUNDRY COMPANY**

2511 NORTH 9TH STREET, ST. LOUIS, MO 63102  
314-231-8738 800-231-3090 FAX 314-231-2820  
<http://www.hydrants.com>