


#66WC-D SAMPLING STATION SPEC SHEET

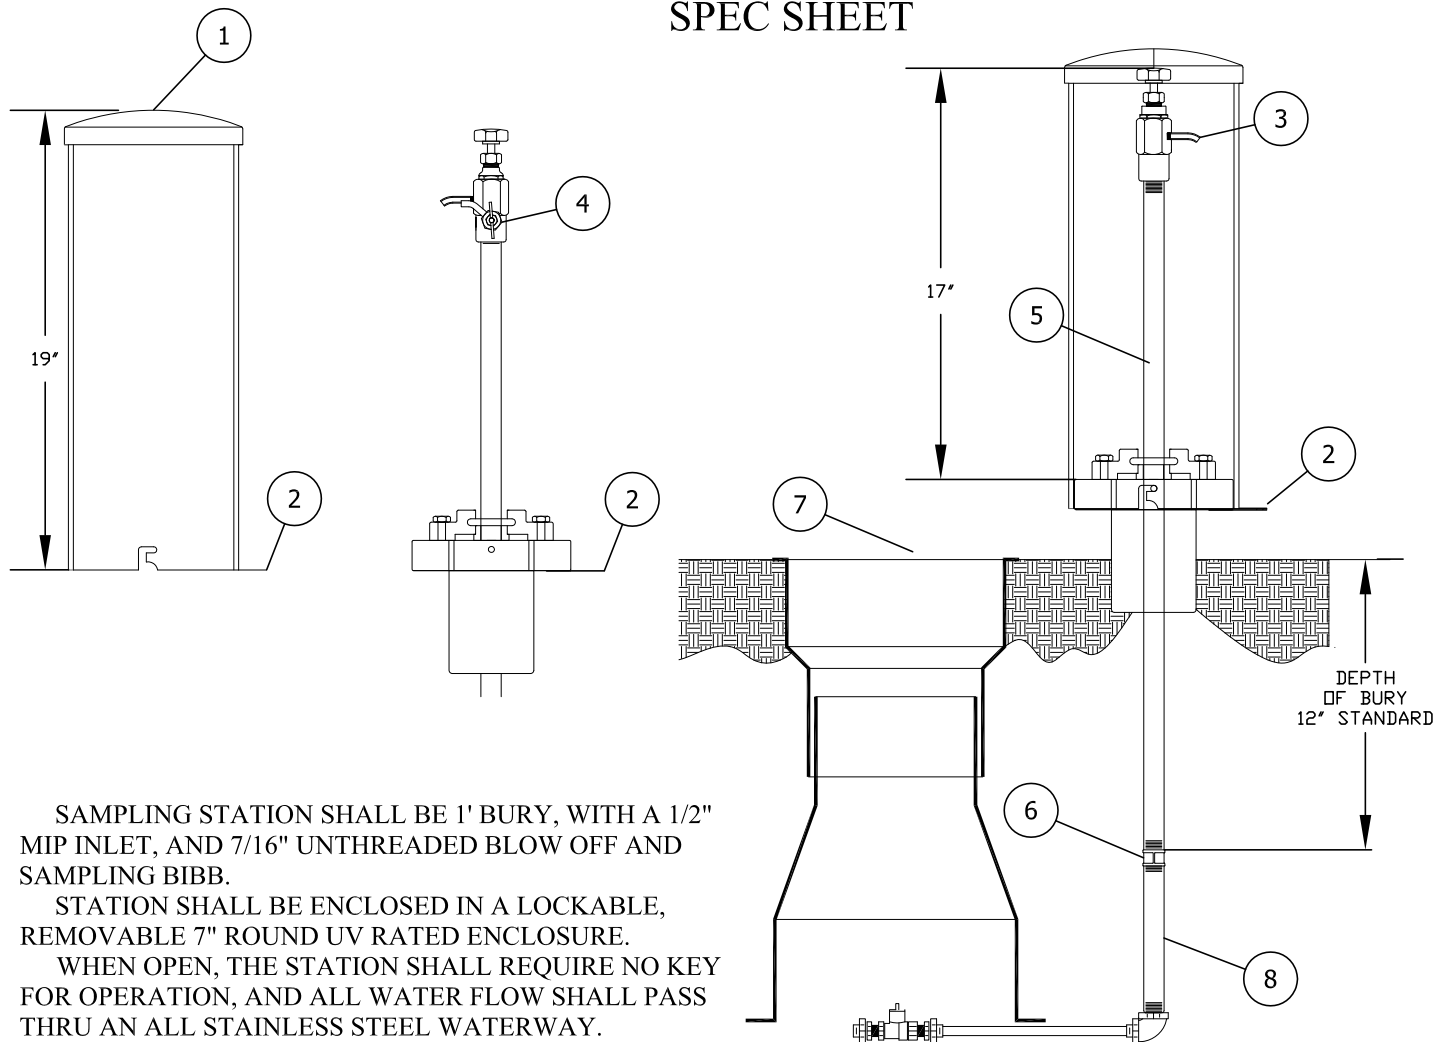

SAMPLING STATION SHALL BE 1' BURY, WITH A 1/2" MIP INLET, AND 7/16" UNTHREADED BLOW OFF AND SAMPLING BIBB.

STATION SHALL BE ENCLOSED IN A LOCKABLE, REMOVABLE 7" ROUND UV RATED ENCLOSURE.

WHEN OPEN, THE STATION SHALL REQUIRE NO KEY FOR OPERATION, AND ALL WATER FLOW SHALL PASS THRU AN ALL STAINLESS STEEL WATERWAY.

ALL WORKING PARTS SHALL BE OF STAINLESS STEEL AND SERVICABLE FROM ABOVE GROUND WITH NO DIGGING OR REPLACEMENT NEEDED.

THE STATION SHALL BE MODEL #66WC-D AS MANUFACTURED BY THE KUPFERLE FOUNDRY, ST. LOUIS MO. 63102 OR APPROVED EQUAL.

NOTES:

IN SOME CONDITIONS CORROSION OF STAINLESS STEEL CAN OCCUR (EXPOSURE TO SALT WATER, DIRECT EXPOSURE TO STRONG CHLORIDES, ETC.). PROPER MAINTENANCE OF THE EXPOSED STAINLESS STEEL PARTS USING PROPER STAINLESS STEEL CLEANING AGENTS WILL INCREASE THE LIFESPAN OF THE HYDRANT. IF DESIRED, KUPFERLE CAN ALSO OFFER AN ADDITIONAL PASSIVATION PROCESS FOR ADDITIONAL CORROSION PROTECTION.

ITEM	ITEM / DESCRIPTION	NOTES
1	7" ROUND UV RESISTANT ENCLOSURE	
2	LOCKING BRACKET	
3	BLOW OFF	
4	PET COCK SAMPLING BIBB	
5	1/2" S.S. WATERWAY	
6	1/2" S.S. COUPLING	BY OTHERS
7	VALVE BOX	BY OTHERS
8	1/2" S.S. NIPPLE	BY OTHERS

#66WC-D SAMPLING STATION TO BE INSTALLED AT THE FOLLOWING LOCATIONS:

DD/MM/YY	ISSUED FOR REFERENCE
DATE	STATUS / REVISION

#66WC-D SAMPLING STATION

SHEET 1 OF 1

DRAWN
BAM
APPROVED
DCL
DATE
6/1/15
SCALE
1-1/2"=1'



2511 NORTH 9TH STREET
ST. LOUIS, MO 63102
1-800-231-3990
FAX 314-231-2820
www.hydrants.com